

Project Name: _____	Approval: _____
Location: _____	Date: _____
Engineer: _____	Construction: _____
Submitted to: _____	Unit #: _____
Submitted by: _____	Drawing #: _____
Reference: _____	

MODEL COMPATIBILITY:

Compatible with VRV indoor unit models: FXAQ, FXDQ, FXEQ, FXFQ, FXHQ, FXLQ, FXMQ, FXMQ_MF, FXNQ, FXSQ, FXTQ, FXUQ, FXZQ, VAM*

Compatible with SkyAir indoor unit models: FAQ, FBQ, FCQ, FHQ, FTQ

Compatible with Single Zone/Multi Zone/SkyAir system indoor unit models:

- FDMQ, FFQ_Q
- FFQ_LVJU with the use of the Interface Adaptor DTA112BA51
- FTXS, CTXS, CTXG, FTXG, FDXS, CDXS, FVXS with the use of the DIII-Net Adapter KRP928BB2S
- FTX, FTXN, FTK, and FTKN with the use of the DIII-Net Adapter KRP928BB2S and an Interface adaptor KRP067A41E/KRP980B1/KRP980B2E

*iTM Server Gateway Option is not compatible with VAM unit

SPECIFICATIONS:

Model	DCM601A71	DCM601A72
Description	intelligent Touch Manager (iTM)	iTM Plus Adaptor
Maximum Indoor Unit Groups	64	64
Max Indoor Units	128	128
Max Outdoor Units	10	10
Max BACnet Servers	50	-
System Total	512 Indoor Unit Groups (1024 Indoor Units)	
Power Supply	24 VAC, 60 Hz	24 VAC, 60 Hz
Power Consumption	23 Watts	23 Watts
Operating Temp Range	32-104°F	14 - 122°F
Operating Humidity Range	85% or less (w/o condensation)	85% or less (w/o condensation)
Dimensions (WxHxD)	11.42 x 9.57 x 1.97 in.	6.30 x 5.87 x 2.41 in.
Weight (Mass)	5.3 lbs. (2.4 kg)	1.1 lbs. (0.5 kg)
Certifications	FCC Part 15 Class B	
DIII-NET Systems	1	1
RJ-45 (Ethernet) 100Base-TX or 10Base-T	2	N/A
USB Port-USB2.0 (2GB to 32GB)	1	N/A
RS485 (19 - 22 AWG)	1	1
Digital Input forced shutdown of all indoor unit systems	1	N/A
Digital Input and/or Pulse Input Terminals	3 x 10 mA @ 16 VDC/ 3 x 1 pulse at 1 or 10 kWh at 100 ms interval	4 x 10 mA @ 16 VDC/ 4 x 1 pulse at 1 or 10 kWh at 100 ms interval

PRODUCT IMAGE:



iTM



iTM Plus Adaptor (Optional)

Daikin North America LLC, 5151 San Felipe, Suite 500, Houston TX, 77056
www.daikinac.com www.daikincity.com

(Daikin's products are subject to continuous improvements. Daikin reserves the right to modify product design, specifications and information in this data sheet without notice and without incurring any obligations)



Submittal Data Sheet

DCM601A71 – intelligent Touch Manager

Project Name: _____

Location: _____

Engineer: _____

Submitted to: _____

Submitted by: _____

Reference: _____

Approval: _____

Date: _____

Construction: _____

Unit #: _____

Drawing #: _____

OPTIONS:

- Software Options:
 - Web/Email Software standard
 - Power Proportional Distribution (PPD) Option (DCM002A71)⁽¹⁾
 - BACnet Client Option Software (DCM009A51)
 - BACnet/IP Server Gateway Option (DCM014A51)⁽²⁾⁽³⁾
- Hardware Options:
 - iTM Plus Adapter(DCM601A72) for expanding indoor unit groups up to 512 groups (1024 indoor units)
 - WAGO I/O basic kit (60359653) and I/O modules for controlling/ monitoring of external equipment via Di, Do, Ai, Ao and Pi
 - Digital Input (DEC101A51-US2) for monitoring of external equipment
 - Digital Input/Output (DEC102A51-US2) for controlling / monitoring of external equipment

Notes:

- (1) The Power Proportional Distribution (PPD) option supplies the user with a reasonably calculated apportionment of the total power consumption by the Daikin air-conditioning system to individual units on the system. Because input to the PPD includes measured pulses in the refrigerant system and because the air-conditioning system includes a number of variables, to include operating temperatures and pressures, piping lengths, heat exchange rates and others, no meter-type apportionment of individual user's consumption can be made. However, the PPD feature provides an apportionment methodology that uses highly advanced technology as applied to the many variables in the air-conditioning system.
- (2) The BACnet Server Gateway option cannot use together with the BACnet Client software option and the PPD option.
- (3) BACnet/IP Server Gateway option is not compatible with the VAM unit.

FEATURES:

1. **Management size** - up to 512 indoor unit groups (1024 indoor units)
 - a. The iTM can manage one (1) DIII-Net system which can have up to 64 indoor unit groups (128 indoor units).
 - b. The iTM can manage up to eight (8) DIII-Net systems with the addition of the iTM Plus Adapter which can manage one (1) DIII-Net system each. This means up to seven (7) iTM adapters can be daisy chained to the iTM
2. **Control / Monitoring**
 - a. Independent Cool and Heat setpoints
 - i. Setpoint tracking for full range of setpoint differentials
 - b. Independent Cool and Heat Setback setpoints (unoccupied)
 - i. Adjustable timed override
 - c. Room temperature displayed in 0.1°F
 - d. Scheduling: 7, 5+2, 5+1+1, 1 (Everyday) weekly patterns
 - i. Optimum Start
 - e. Auto-changeover: Fixed, Individual, Average, and Vote
 - i. Weighted demand (0-3) configurable for Average and Vote methods
 - ii. Adjustable (1-4°F) Primary and Secondary changeover bands
3. **Web Accessibility**
 - a. Web and Alert Email function standard with iTM
 - b. All iTM configuration/setup can be done through Web Option or touch screen
4. **Visual Navigation Screen**
 - a. Floor plan layout view is available
 - b. Graphical User Interface (GUI) for BACnet IP Client management points
5. **Easy installation**

Daikin North America LLC, 5151 San Felipe, Suite 500, Houston TX, 77056

www.daikinac.com www.daikincity.com

(Daikin's products are subject to continuous improvements. Daikin reserves the right to modify product design, specifications and information in this data sheet without notice and without incurring any obligations)



Submittal Data Sheet

DCM601A71 – intelligent Touch Manager

Project Name: _____	Approval: _____
Location: _____	Date: _____
Engineer: _____	Construction: _____
Submitted to: _____	Unit #: _____
Submitted by: _____	Drawing #: _____
Reference: _____	

- a. Wall mount and flush mount installation
- b. Automatic indoor unit registration and indoor unit model detection
- 6. Easy Engineering**
 - a. iTM can be configured off site via Pre-setting Tool
 - b. All data can be uploaded and downloaded by USB flash drive
- 7. Building facilities management**
 - a. The iTM is equipped with 3 digital/pulse inputs and the iTM Plus Adapter comes equipped with 4 digital/pulse inputs
 - b. Building ancillary equipment can be connected by using the WAGO I/O system (optional)
 - i. I/O configuration for Digital Input, Digital Output, Analog Input, Analog Output and Pulse Input
 - c. BACnet IP Client management points with BACnet Client option (optional)
 - i. AI, AO, AV, BI, BO, BV, MI, MO and MV
 - d. Tenant billing with PPD option(optional)
- 8. BACnet Client (Optional)¹**
 - a. Monitor and control equipment and sensors connected to a BACnet server via BACnet IP
 - i. Up to 50 BACnet IP servers can be connected
- 9. BACnet Server Gateway (Optional)¹**
 - 1. Provide function to monitor and control indoor units by BMS via BACnet IP.
 - i. Up to 128 indoor units groups.
 - ii. Individual and configurable Device ID for each indoor unit group.
 - i. Virtual router function embedded
- 10. History**
 - a. All errors, operations, automatic controls and status changes are stored in history (up to 500,000 items)
- 11. D-Net compatible (Service option)**
 - a. Remote monitoring of VRV equipment status and reporting

WIRING SPECIFICATION:

Specifications of Communication Cabling	
DIII-Net	
Type	2-conductor, stranded, non-shielded copper cable / PVC of vinyl jacket
Size	AWG 18-2
Total Length	Maximum wiring distance between units 3,280 ft. Total wire length 6,560 ft.
iTM Plus Adapter	
Type	2-conductor, stranded, non-shielded copper cable / PVC of vinyl jacket
Size	AWG 18-2
RS485 Length	Maximum distance between iTM and furthest iTM Plus Adapter 150 ft.
Total Length	Maximum wiring distance between units 3,280 ft. Total wire length 6,560 ft.
WAGO	
Type	2-conductor, stranded, non-shielded copper cable / PVC of vinyl jacket (CPEV or FCPEV)
Size	2 Wire AWG 24 - 18 stranded
Total Length	Maximum wiring distance between iTM and Bus Coupler 1640 ft.

Daikin North America LLC, 5151 San Felipe, Suite 500, Houston TX, 77056
www.daikinac.com www.daikincity.com

(Daikin's products are subject to continuous improvements. Daikin reserves the right to modify product design, specifications and information in this data sheet without notice and without incurring any obligations)



Submittal Data Sheet

DCM601A71 – intelligent Touch Manager

Project Name:	Approval:
Location:	Date:
Engineer:	Construction:
Submitted to:	Unit #:
Submitted by:	Drawing #:
Reference:	

BACNET CLIENT OPTION MANAGEMENT POINTS:

- The following BACnet object types can be monitored and controlled by iTM through BACnet Client Option (DCM009A51) via BACnet/IP protocol:

Object Type #	Object Name	Description
0	Analog Input	Analog input value such as a temperature and measurement value
1	Analog Output	Analog output value such as a setting value (For example, can be used as the analog input value of a setting value)
2	Analog Value	Analog input value such as a temperature and measurement value or analog output value such as a setting value
3	Binary Input	Digital input value such as an On/Off status and error status
4	Binary Output	Digital output value such as an On/Off operation (For example, can be used as the digital input value of an On/Off operation)
5	Binary Value	Digital input value such as an On/Off status and error status or digital output value such as an On/Off operation
13	Multi-state Input	Digital input value such as an operation mode
14	Multi-state Output	Digital output value such as an operation mode (For example, can be used as the digital input value of an operation mode)
19	Multi-state Value	Digital input value such as an operation mode or digital output value such as an operation mode

BACNET/IP SERVER GATEWAY OPTION POINTS LIST:

- System Configuration points linked to iTM control logic (one set of points per iTM):

Point Name	Point Description
Enable ITM Schedule Operation	Enable or Disable iTM Schedule operation
Enable ITM Auto Changeover Operation	Enable or disable iTM Auto changeover logic.
Timed Override Minutes	Set override time in minutes
System Forced Off	The Forced System Stop command will force the indoor unit to stop running. Remote controllers will be locked out from restarting indoor units during the forced system stop event.

- Indoor unit monitoring Points (one set of points per indoor unit):

Point Name	Point Description
Unit On_Off Status	Monitors if the indoor unit fan is On or Off
Alarm Status	Monitors whether or not the indoor unit is operating normally, and issues an alarm if the indoor unit has a malfunction. Error Code is shown in the description.
Room Temperature	Monitors and displays the room temperature.
Unit On Details	Indoor unit details operation Off - Normal (ON) - Override - Setback

Daikin North America LLC, 5151 San Felipe, Suite 500, Houston TX, 77056
www.daikinac.com www.daikincity.com

(Daikin's products are subject to continuous improvements. Daikin reserves the right to modify product design, specifications and information in this data sheet without notice and without incurring any obligations)



Submittal Data Sheet

DCM601A71 – intelligent Touch Manager

Project Name: _____	Approval: _____
Location: _____	Date: _____
Engineer: _____	Construction: _____
Submitted to: _____	Unit #: _____
Submitted by: _____	Drawing #: _____
Reference: _____	

Filter Sign Status	Monitors filter run time and provides service alert.
Indoor Fan Status	Monitors if the indoor unit fan is On or Off
Communication Status	Monitor if the communication is Normal or in Alarm
Thermo-on Status	Monitors whether or not the indoor unit is actively cooling or heating.
Compressor Status	Monitors if the compressor of the outdoor unit is On/Off/Defrost
Aux Heater Status	Monitors if the external heater controlled by the indoor unit is operating.
Changeover Option	Monitor if iTM changeover logic is Active.

- Indoor unit monitoring and control Points (one set of points per indoor unit):


Point Name	Point Description
Occupancy Mode	Set the occupancy of the indoor unit Occupied , Unoccupied or Standby
Operation mode	Set Cool - Heat -Fan -Dry operation mode. for the indoor unit and monitors the latest mode
Occ Cooling Setpoint	Sets the occupied cooling setpoint of the indoor unit and monitors the latest setpoint value.
Occ Heating Setpoint	Sets the occupied heating setpoint of the indoor unit and monitors the latest setpoint value.
Unocc Cooling Setpoint	Sets the unoccupied cooling setpoint of the indoor unit and monitors the latest setpoint value.
Unocc Heating Setpoint	Sets the occupied heating setpoint of the indoor unit and monitors the latest setpoint value.
Max Cooling Setpoint	Sets the maximum cooling setpoint of the indoor unit and monitors the latest setpoint value.
Min Cooling Setpoint	Sets the minimum cooling setpoint of the indoor unit and monitors the latest setpoint value.
Max Heating Setpoint	Sets the maximum Heating setpoint of the indoor unit and monitors the latest setpoint value.
Min Heating Setpoint	Sets the minimum heating setpoint of the indoor unit and monitors the latest setpoint value.
Min Setpoint Differential (Cooling & Heating)	Set the minimum differential value between cooling and heating setpoint and monitor the latest differential value.
Cooling & Heating Setpoint Tracking Mode	Enable or Disable iTM setpoint tracking mode.
Fan speed	Sets the indoor unit fan speed and monitors the latest setting
Timed Override Operation	Enable or Disable iTM override timer
Remote Controller Prohibit (On_Off)	Permits or prohibits the remote controller to control the indoor unit's On/Off.
Remote Controller Prohibit (Operation Mode)	Permits or prohibits the remote controller to control the indoor unit's Operation mode.
Remote Controller Prohibit (Setpoint)	Permits or prohibits the remote controller to control the indoor unit's Setpoint.
Filter Sign Reset	Clears the Filter sign status.
Forced Thermo-off	Force the indoor unit to stop actively cooling or heating.

Project Name: _____
 Location: _____
 Engineer: _____
 Submitted to: _____
 Submitted by: _____
 Reference: _____


Approval: _____
 Date: _____
 Construction: _____
 Unit #: _____
 Drawing #: _____

DIMENSIONS:

iTM:

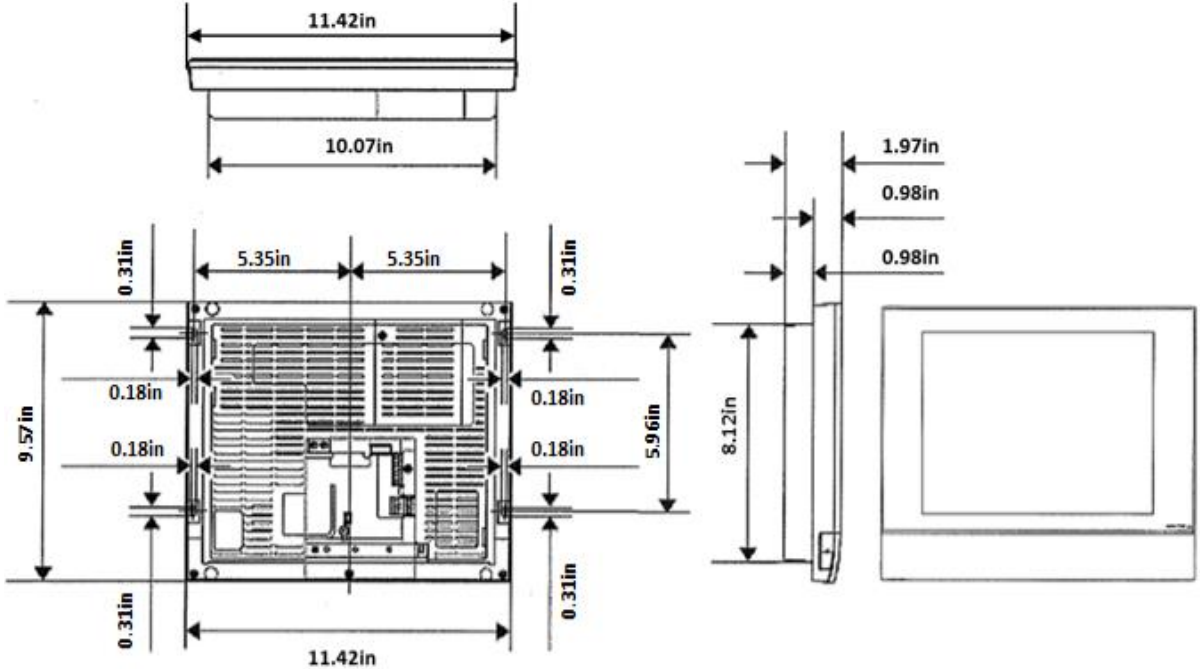

iTM Plus Adaptor:

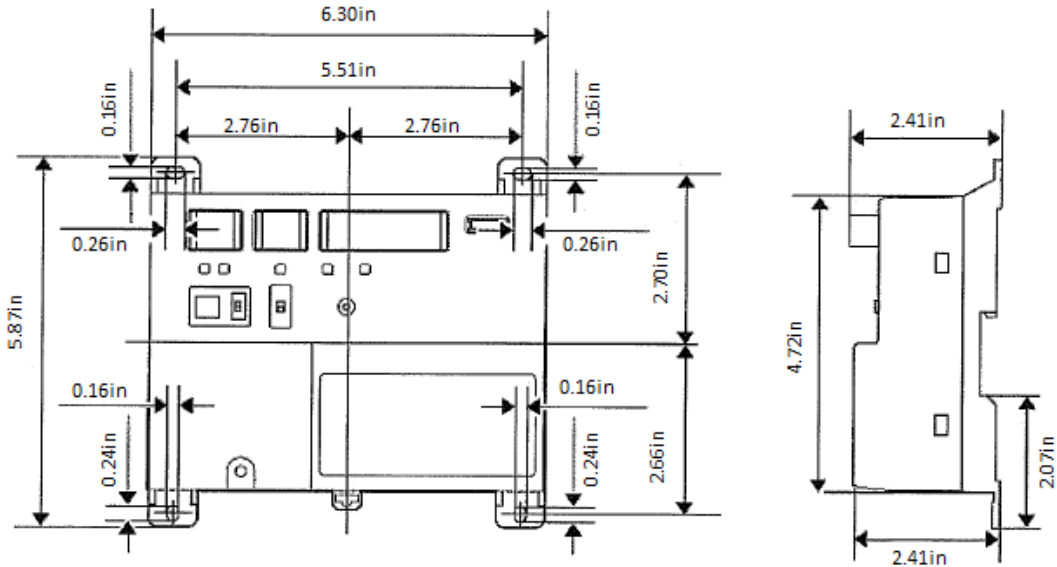



Submittal Data Sheet

DCM601A71 – intelligent Touch Manager

Project Name:		Approval:	
Location:		Date:	
Engineer:		Construction:	
Submitted to:		Unit #:	
Submitted by:		Drawing #:	
Reference:			

DOCUMENTATION:

Documentation available on www.daikincity.com and/or www.daikinac.com:

- Submittal
- Sales Brochure
- Guide Specs
- Installation Manual
- Operation Manual
- iTM BACnet Server Gateway
 - Design Guide
 - Sales Flyer
 - Quick User Guide
- iTM BACnet Client
 - Sales Flyer
- WAGO I/O basic kit and modules
 - Submittal
 - Installation Manual
 - Sales Flyer